


THE GAS HOUSE PROPANE INC.

Main Office/Plant
7125 Krick Rd
Walton Hills, Oh 44146
440-439-4474

Cleveland
3804 St Clair Ave
Cleveland, Oh 44114
216-881-8400

Motor Fuel Applications

Lift Truck

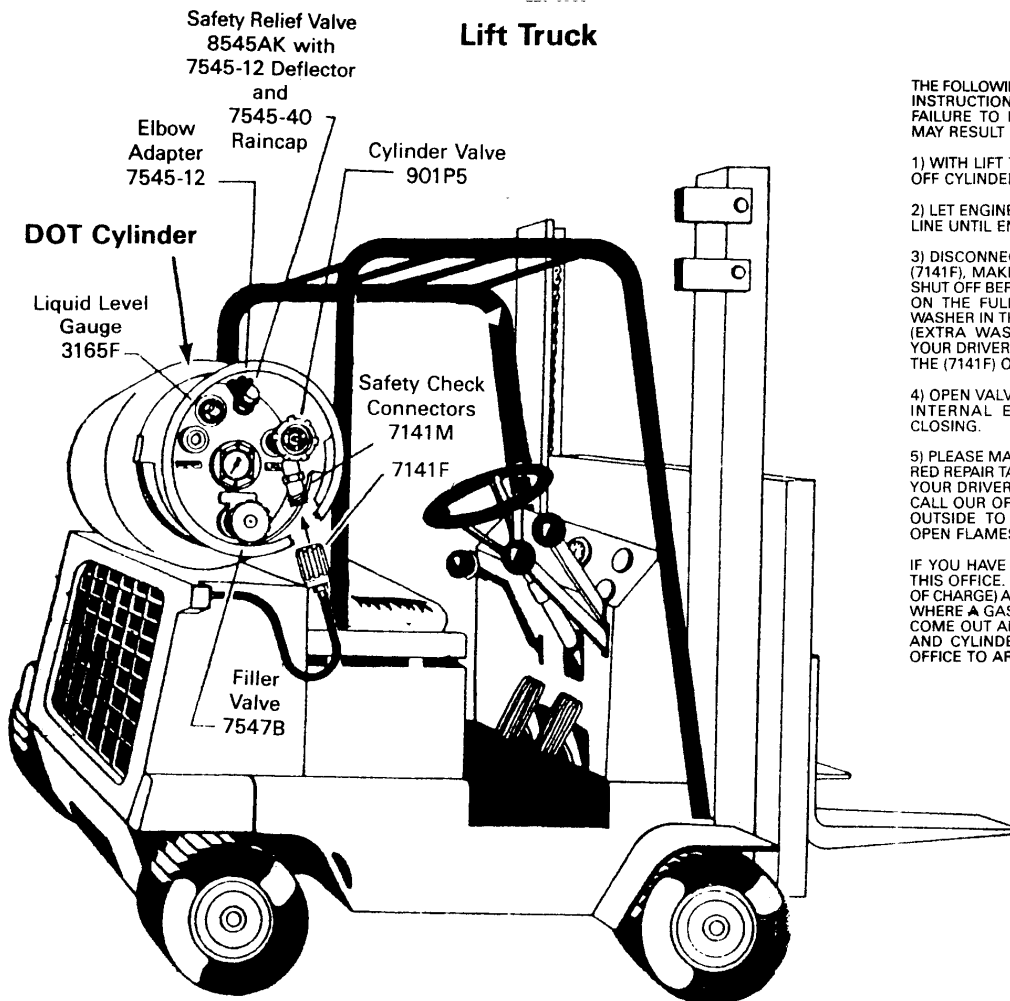

THE FOLLOWING IS THE PROPER INSTALLATION INSTRUCTIONS FOR LIFT TRUCK CYLINDERS. FAILURE TO FOLLOW THESE INSTRUCTIONS MAY RESULT IN SERIOUS BURNS.

- 1) WITH LIFT TRUCK ENGINE RUNNING, SHUT OFF CYLINDER VALVE (901P5) ON TANK.
- 2) LET ENGINE RUN ALL THE GAS OUT OF THE LINE UNTIL ENGINE STALLS.
- 3) DISCONNECT CYLINDER BY UNSCREWING (7141F). MAKING SURE THE VALVE (901P5) IS SHUT OFF BEFORE RECONNECTING THE (7141F) ON THE FULL TANK. BE SURE THERE IS A WASHER IN THE FRONT PART OF THE (7141M). (EXTRA WASHERS ARE AVAILABLE FROM YOUR DRIVER FREE OF CHARGE). RECONNECT THE (7141F) ONTO THE NEW FULL TANK.
- 4) OPEN VALVE (901P5) SLOWLY TO PREVENT INTERNAL EXCESS FLOW VALVE FROM CLOSING.
- 5) PLEASE MARK ANY DEFECTIVE TANKS WITH RED REPAIR TAGS WHICH YOU MAY GET FROM YOUR DRIVER. IF YOU HAVE A LEAKING TANK CALL OUR OFFICE AT ONCE, AND TAKE TANK OUTSIDE TO AN OPEN AREA AWAY FROM OPEN FLAMES.

IF YOU HAVE ANY QUESTIONS PLEASE CALL THIS OFFICE. THE GAS HOUSE OFFERS (FREE OF CHARGE) A PROGRAM FOR YOUR COMPANY WHERE A GAS HOUSE REPRESENTATIVE WILL COME OUT AND GIVE A CLASS ON PROPANE AND CYLINDER SAFETY. PLEASE CALL OUR OFFICE TO ARRANGE FOR THIS PROGRAM.

Prepared by
NATIONAL PROPANE GAS ASSOCIATION
1600 Eisenhower Lane, Suite 100
Lisle, Illinois 60532
Phone: 708/515-0600

Printed in U.S.A.

The purpose of this bulletin is to set forth general safety practices for the installation, operation, and maintenance of L.P.-gas equipment. It is not intended to be an exhaustive treatment of the subject, and should not be interpreted as precluding other procedures which would enhance safe L.P.-gas operations. Issuance of this bulletin is not intended to nor should it be construed as an undertaking to perform services on behalf of any party either for their protection or for the protection of third parties. The National Propane Gas Association assumes no liability for reliance on the contents of this bulletin.

COPYRIGHT 1989 NATIONAL PROPANE GAS ASSOCIATION

MATERIAL SAFETY DATA SHEET

Section 1 – Chemical Identification

Emergency Number: 800-633-8153

CAS NO: 74-98-6

Formula: C₃H₈

DOT ID Number: UN 1075

Chemical Name Liquefied Petroleum Gas or Propane

Chemical Family: Paraffinic Hydrocarbon

DOT Label: Flammable Gas

Section 2 – Hazardous Ingredients

Hazardous Mixtures: Air with 2.1 to 9.5% Propane

OSHA PEL: 1,000 ppm (1,800 MG/M³)

IDLH: 2,100 ppm (3,780 mg/m³)

Section 3 – Physical Data

Boiling Point: -44 F

Specific Gravity: 0.51 @ 60 F (H₂O=1)

Vapor Pressure at 100 F: 208 psi Maximum

Volatility by Volume: 100%

Vapor Density: 1.52 (Air=1)

Evaporative Rate: >1 (Ethel Ether=1)

Solubility in H₂O: Negligible

Appearance and Odor: Clear and odorless (unpleasant odor created by odorant)

Section 4 – Fire and Explosion Hazard Data

Flammable Limits (% Volume in Air):LEL:2.1 UEL:9.5

Flashpoint: -156 F (Estimate)

Extinguishing Media: Dry Chemical, CO₂, Water Spray, Fog or Foam

Special Fire Fighting Procedures: Stop flow of gas. Use water to keep containers exposed to fire cool. Use water spray to disperse un-ignited gas or vapor. If ignition has occurred and no water is available, tank metal may weaken from overheating. Evacuate area. If gas has not ignited, LP gas liquid or vapor may be dispersed by water spray or flooding.

Caution: Vapors are heavier than air and may spread on the ground. Evacuate area of all unnecessary personnel. USE NIOSH/MSHA approved self-contained breathing apparatus

Section 5 – Health Hazards

Routes of Entry: Inhalation and Skin (liquid contact). Target organs: Central nervous system and skin. Effects of over-exposure: breathing propane vapors can lead to symptoms ranging from dizziness to anesthesia and respirator arrest. Eyes – moderate irritation. Contact with liquid may cause frostbite due to rapid vaporization. Emergency and First Aid Procedures: Get immediate medical attention. If liquid propane makes contact with skin, immediately flush with warm water for at least 15 minutes. DO NOT USE HOT WATER. If someone inhales propane, administer oxygen if breathing is difficult or artificial respiration if the subject is not breathing.

Section 6 – Reactivity Data

Stable: Yes

Hazardous Decomposition Products: None

Incompatibility (materials to avoid): Mixing with oxygen or air, except at burner

Hazardous Polymerization: Will not occur

Section 7 – Spill or Leak Procedures

Steps to be taken in case propane is released: Keep public away. Shut off supply of gas. No flares, smoking or flames in hazard area. Ventilate area. Stop the leak if it can be done without risk. Disperse with water spray.

Waste Disposal Method: Ensure conformity with local disposal regulation. Vent vapor to a safe location. Ensure dissipation of gas below the lower explosive limit (LEL). Consult applicable ordinances for compliance.

Section 8 – Special Protection Information

Respiratory Protection: NIOSH/MSHA approved respirator when at, or above, the PEL. In IDLH use self-contained breathing apparatus. Ventilation: Use explosion-proof equipment and keep resources of ignition at safe distances. Personal Protection Equipment and Apparel: Gloves impervious to the action of propane liquid. Eye Protection: Chemical splash goggles, face shield when handling liquids.

Section 9 – Special Precautions

Precautions to be taken when handling and storing: Store outside. Keep containers away from heat sources and store in upright position. Containers should be dropped. Keep container valve closed and plugged when not in use.

Other precautions: Store away from likely ignition sources.

Section 10 – Toxicological Information

Carcinogenicity:

National Toxicological Program (NTP): No

International Agency for Research on Cancer (IARC): No

Occupational Safety and Health Administration (OSHA): No

Section 11 – DOT Labeling Information (49 CFR 100-199)

Shipping Name: Propane

Hazardous Classification: 2.1 Flammable Gas

Identification No. UN 1075

Label(s) Required: Flammable Gas

Placard: Flammable Gas/1075

RCRA Classification: Ignitable (for unadulterated product as a waste)